




PRODUCT TYPE A

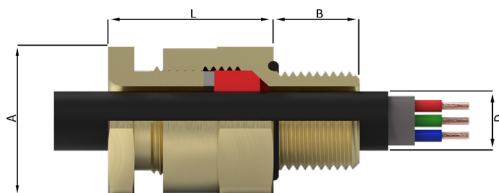

EXAMPLE PART NUMBERING:
A2LBF/NP/20/M20

OPTIONS	A	Type of gland featuring controlled displacement sealing
	2	Neoprene Seals (2) - Silicone (3) - Neoprene/Lead (1) - Silicone/Lead (4)
	L	Peppers Standard Designation
	B	Aluminium (A) / Brass (B) / Stainless Steel (S)
	F	Multiple Certification
	C	PVC Shroud (C) - PCP Shroud (P) - Silicone LSOH Shroud (3)
	K-V-H	Locknut & Nylon (K), Fibre (V) or PTFE (H) IP Washer
	T	Including Earth Tag
	S	Including Serrated Washer
	1	Quantity per kit
	NP	Nickel Plated
	20	Gland shell size
	M20	M20 x 1.5mm Male Entry Thread

OPTIONAL
ACCESSORIES:

LOCKNUT	Brass (ACBLN) / St Steel (ACSLN) / Aluminium (ACALN)
EARTH TAG	Brass (ACBET) / St Steel (ACSET) / Aluminium (ACAET)
IP WASHERS	Nylon (ACNSW) / Fibre (ACFSW) / PTFE (ACPSW)
SERRATED WASHERS	Stainless Steel (ACSSW)
SHROUDS	PVC (ACSPVC) / PCP (ACSPCP) / Silicone LSOH (ACSSIO)

IP RATING:	IP66 & IP68 (50 metres - 7 Days), Type 4X
OPERATING TEMP:	Neoprene Seals -35°C to +90°C
	Silicone Seals -60°C to +180°C
MATERIALS:	Aluminium, Brass or Stainless Steel
PLATING:	Electroless Nickel

CABLE GLAND SELECTION TABLE
(ALL DIMENSIONS IN mm)

Gland size	Entry Thread Size		ISO Thread Length [B]	Cable Acceptance Details		Nominal Protrusion Length [L]	Dimensions/Weight (Metric Versions)			Shroud Size (Metric)
	Metric	NPT		Min	Max		Across Flats [A]	Across Corners	Weight (Kgs)	
12	M12 x 1.5	3/8"	16	0.9	6.0	33	19.0	21.0	0.038	L19
12	M16 x 1.5	3/8" or 1/2"	16	0.9	6.0	33	25.4	28.0	0.068	L24
12	M20 x 1.5	3/8" or 1/2"	16	0.9	6.0	33	25.4	28.0	0.082	L24
16	M16 x 1.5	3/8" or 1/2"	16	4.0	8.4	33	25.4	28.0	0.097	L24
16	M20 x 1.5	1/2" or 3/4"	16	4.0	8.4	33	25.4	28.0	0.104	L24
20S	M20 x 1.5	1/2" or 3/4"	16	7.2	11.7	33	25.4	28.0	0.102	L24
20	M20 x 1.5	1/2" or 3/4"	16	9.4	14.0	33	30.0	33.0	0.127	L30
25	M25 x 1.5	3/4" or 1"	16	13.5	20.0	33	37.6	41.4	0.166	L38
32	M32 x 1.5	1" or 1 1/4"	16	19.5	26.3	33	46.0	50.6	0.244	L46
40	M40 x 1.5	1 1/4" or 1 1/2"	16	23.0	32.2	37	55.0	60.5	0.396	L55
50S	M50 x 1.5	1 1/2" or 2"	16	28.1	38.2	37	65.0	71.5	0.558	L65
50	M50 x 1.5	2"	16	33.1	44.1	37	65.0	71.5	0.438	L65
63S	M63 x 1.5	2" or 2 1/2"	19	39.2	50.1	37	80.0	88.0	0.832	L80
63	M63 x 1.5	2 1/2"	19	46.7	56.0	37	80.0	88.0	0.664	L80
75S	M75 x 1.5	2 1/2" or 3"	19	52.1	62.0	37	90.0	99.0	0.924	L90
75	M75 x 1.5	3"	19	58.0	68.0	37	90.0	99.0	0.714	L90
80	M80 x 2.0	3" or 3 1/2"	25	62.2	72.0	50	104.0	115.2	1.514	L104
85	M85 x 2.0	3" or 3 1/2"	25	69.0	78.0	50	104.0	115.2	1.332	L104
90	M90 x 2.0	3 1/2" or 4"	25	74.0	84.0	50	114.0	125.7	1.622	L114
100	M100 x 2.0	3 1/2" or 4"	25	82.0	90.0	50	114.0	125.7	1.523	L114

NOTES

- Gland size does not necessarily equate to the entry thread size.
- The IP O-ring seal is only available on metric entry threads. IP washers can be supplied for tapered entry threads.
- Dimensions (A) & (B) may differ for glands with non metric entry threads. Please refer to our "Thread Reference Tables" for specific dimensions.
- Assembly instructions must be read prior to installation and adhered to in full.
- Peppers supply products with parallel entry threads that conform to the flameproof threaded joint requirements of IEC/EN 60079-1 and other equivalent standards. They usually incorporate a thread run out according to the available machining techniques and will not have a full form thread for the entire length.

Single Compression Gland for Armoured and Unarmoured Cable

Ex db : Ex eb : Ex nR : Ex ta : IP66 : IP68 : Class I Div 2 : AEx e : AEx ta

PART NUMBERS:

A	1	L	B	F
	2		S	
	3		A	
	4			



PRODUCT DESCRIPTION

"A" type glands are certified Flameproof Ex db, Increased Safety Ex eb, Restricted Breathing Ex nR and Dust Protected Ex ta. They are suitable for use in Zone 1 and 2 for Gas Groups IIA, IIB and IIC and additionally for use in Zones 20, 21 and 22 for Dust Groups IIA, IIB and IIC. Also certified for Zone and Division installations for use with Marine Shipboard and Tray Cables under the NEC and CEC. Commonly referred to as "stuffing glands", they provide a controlled pull resistant environmental displacement seal on the cable outer sheath, minimising damage to cables that exhibit "cold flow" characteristics. The gland maintains IP66 & IP68 to 50 metres. It is supplied with an IP O-ring seal as standard on metric entry threads. Options are available for use with LSOH cables and extreme temperature applications. The "A" version is designed to accommodate unarmoured and armoured cables where sealing and retention is required only on the outer sheath.

COMPLIANCE STANDARDS:

EN 60079-0, EN 60079-1, EN 60079-7, EN 60079-15, EN 60079-31
IEC 60079-0, IEC 60079-1, IEC 60079-7, IEC 60079-31 & IEC 60529
C22.2 (see certificate), CAN/CSA 60079-0/1/7, UL514B, UL1203, UL2225, UL50E,
ANSI/UL 60079-0/7, ISA 60079-31

CERTIFICATION:

ATEX	II 1D 2G Ex db IIC Gb / Ex eb IIC Gb / Ex ta IIC Da II 3G Ex nR IIC Gc
IECEx	Ex db IIC Gb / Ex eb IIC Gb / Ex ta IIC Da
CEC - Canada (except size 12)	Class I Division 2, Groups A, B, C & D Class II Division 1, Groups E, F & G Class III, Enclosure Type 4X Class I Zone 1 Ex d IIC / Ex e II
NEC - USA	Class II Division 1, Groups E, F & G Class III, Enclosure Type 4X Class I Zone 1 AEx e IIC Gb Class II Zone 20 AEx ta IIC Da 1Ex d IIC Gb X / 1Ex e IIC Gb X / 2Ex nR IIC Gc X / Ex ta IIC Da X
EAC	Ex db IIC Gb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIC Da
INMETRO - Brazil	Ex d IIC Gb / Ex e IIC Gb
SAC - China	II 2G Ex db IIC Gb / II 2G Ex eb IIC Gb / II 3G Ex nR IIC Gc / II 1D Ex ta IIC Da
UKRAINE	Ex d IIC Gb (Zone 1) Ex e IIC Gb (Zone 2) Ex nR IIC Gc (Zone 2)
CcOE - India	Specified ABS Rules
ABS	
LLOYD'S	Ex d IIC Gb / Ex e IIC Gb / Ex nR IIC Gc / Ex ta IIC Da
RMRS	Ex d IC / Ex d IIC / Ex e IC / Ex e IIC / Ex ta IIC

CERTIFICATION No:

ATEX	SIRA 01ATEX1272X & SIRA 09ATEX1221X
IECEx	IECEx SIR 07.0096X
CEC - Canada	CSA 1356011
NEC - USA	CSA 2627370
EAC	RU C-GB.BH02.B.00693-18
INMETRO - Brazil	NCC 13.2012 X
SAC - China	NEPSI GYJ16.1399X
UKRAINE	CLJ 18.0325 X
CcOE - India	PESO P365300/2 & P365300/5
ABS	14-LD463991-1-PDA
LLOYD'S	10/00056(E1)
RMRS	14.02755.315

Peppers Cable Glands Limited will not be held responsible for clients' installations where this has not been taken into account.

- When selecting IP Washer & Shroud material for use with glands, please be aware of the accessories temperature range to ensure they are suitable for the intended installation.
- Where approval in addition to ATEX, IECEx and CSA is required, this must be clearly requested at time of enquiry / order.